

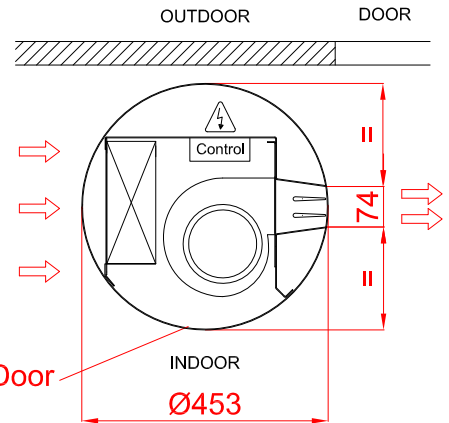
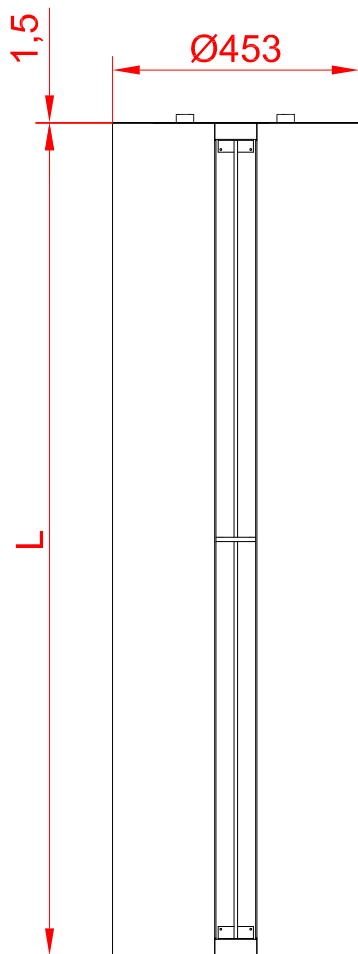


Standard Installation (Vertical Left Side)

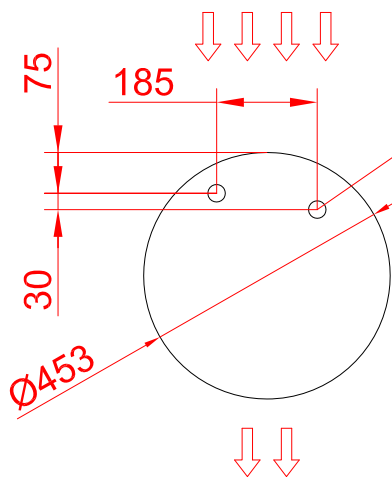


Cables and pipes
entrance
(bottom view)

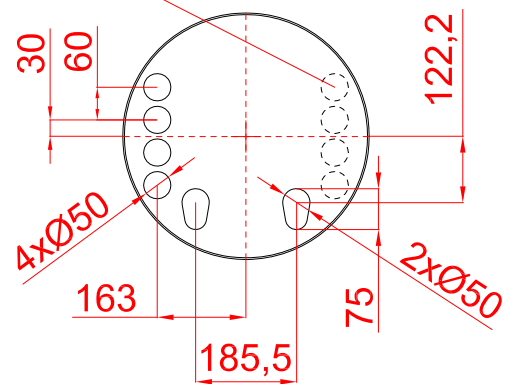

Water-heated units
pipes connection on top
(top view)

L
1025
1525
2030
2530
2980

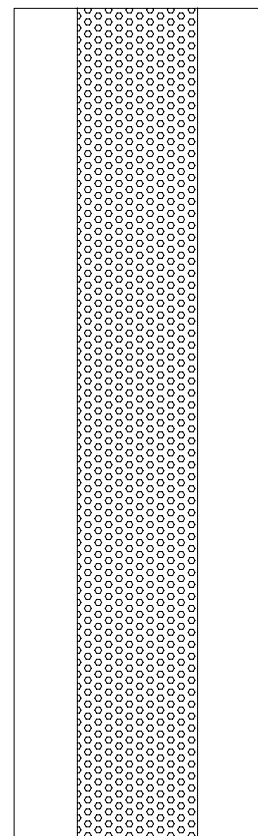

Energi & Klimateknikk AS

Adresse: Baker Østbys vei 5 – 1351 Rud
E-post: Post@ek-teknikk.no
Web.: WWW.ek-teknikk.no
Telefon: 67 17 20 00



Air Curtain Drawing
RUND

1/1 - Rev: 4 (03/11/15)
AIRDOM24030